## FIRE SAFETY KEY

- Self contained maintained directional emergency exit sign illuminated
- (SD) Smoke detector
- (HD) Heat detector
- E Maintained emergency light fitting
- □ Fire Alarm Call Point
- Fire Blanket in Container
- A Carbon Dioxide Fire Extinguisher
- 9 Litre Water Extinguisher
- Dry Powder Extinguisher
- ♠ Foam Fire Extinguisher

FIRE RISK ASSESSMENTS.

ALL SYMBOLS ARE SHOWN TO INDICATE THAT AREA / ROOM SHOULD BE PROVIDED WITH THE RELEVANT FACILITY AND DO NOT NECESSARILY REPRESENT ACTUAL POSITIONS.


THE OPERATORS RESERVE THE RIGHT TO AMEND THE LOCATION OF FIRE SAFETY EQUIPMENT SHOWN ON PLAN.


EQUIPMENT MAY BE MOVED WITH THE AGREEMENT OF THE FIRE OFFICER OR AFTER




## AREA FOR LICENSABLE ACTIVITIES


Items shown on this plan which are not required by the Plans Regulations are for illustrative purposes only, and do not form part of the licence. These items may be moved at the discretion of the Licence Holder. The current location of the fire safety equipment and other safety equipment is as shown. These items may be moved from time to time with agreement of the Fire Officer or after fire risk assessment.

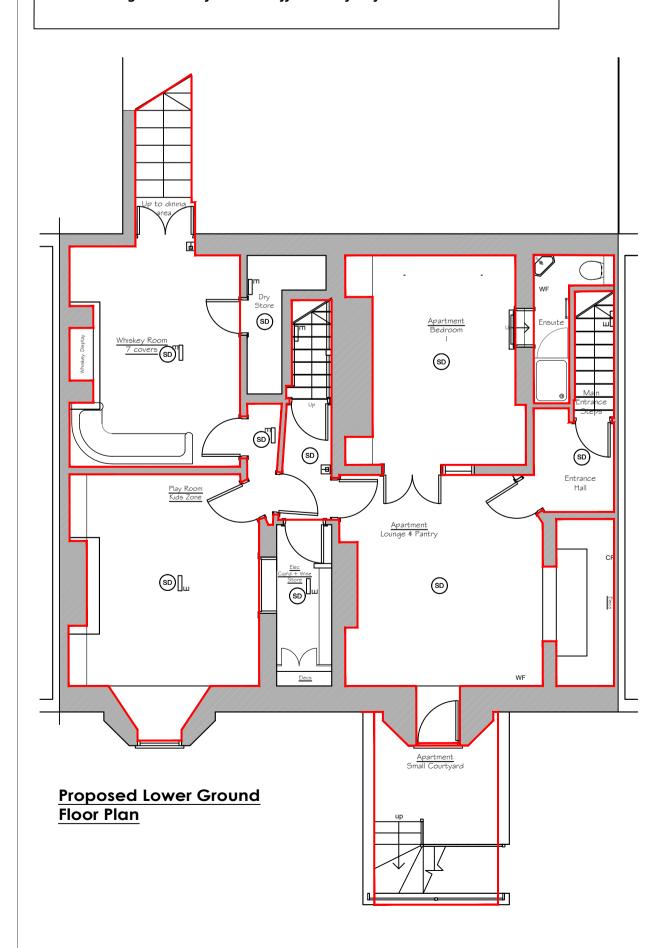

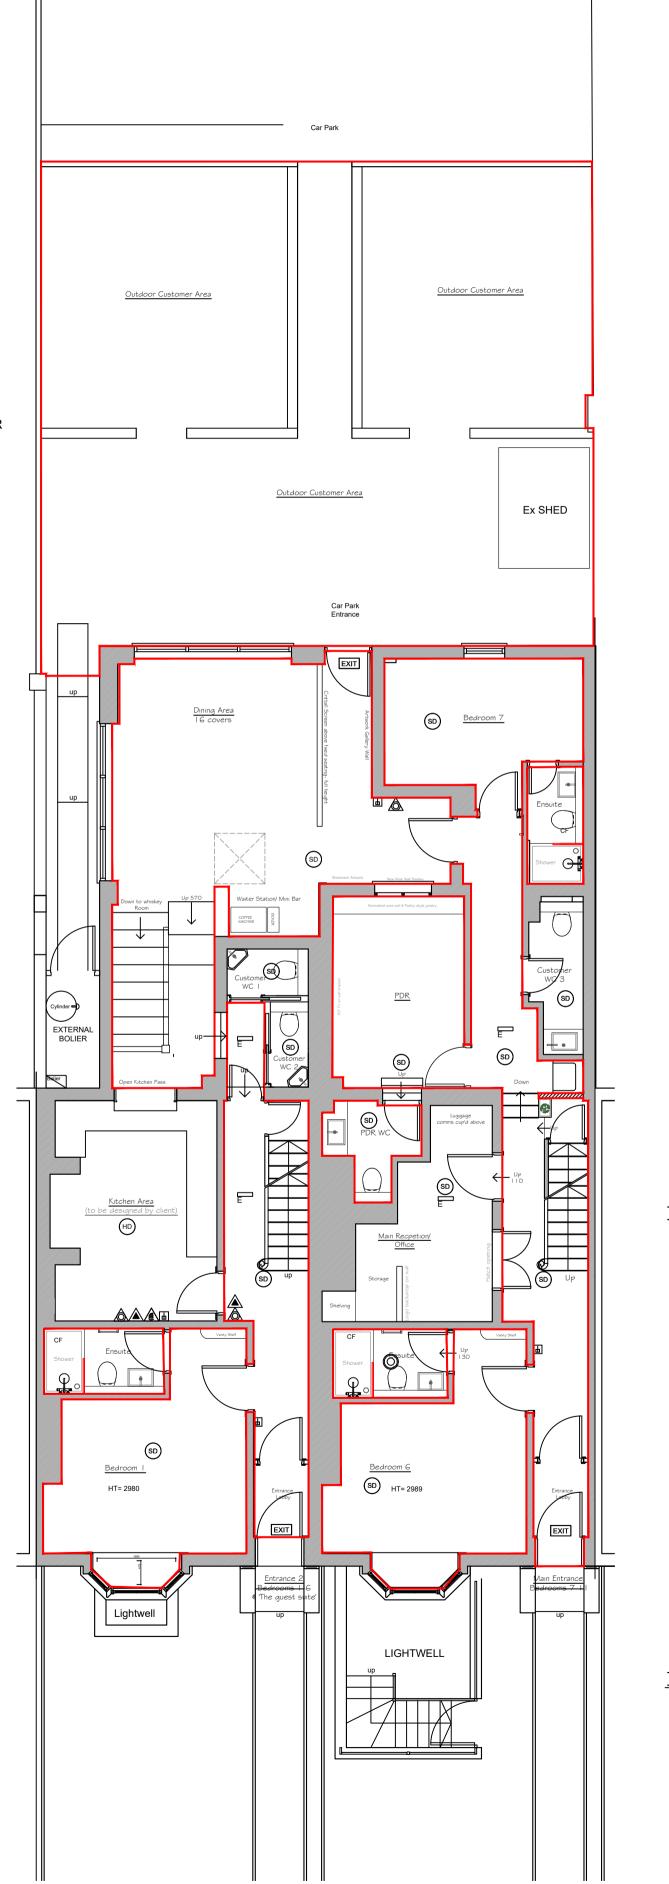


**Proposed Ground Floor Plan** 

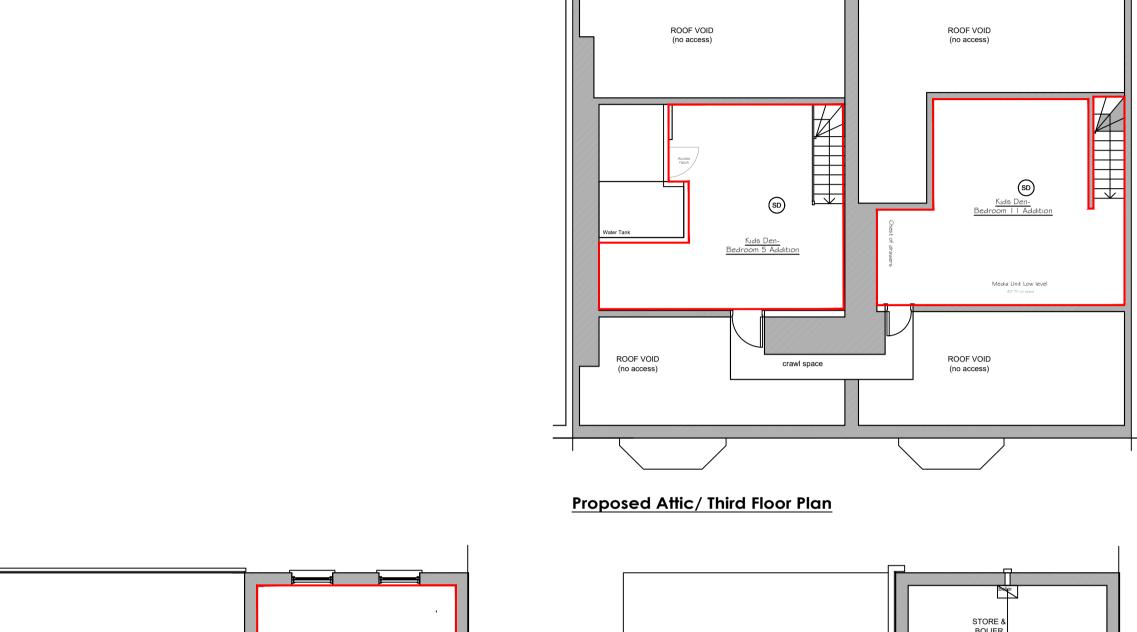

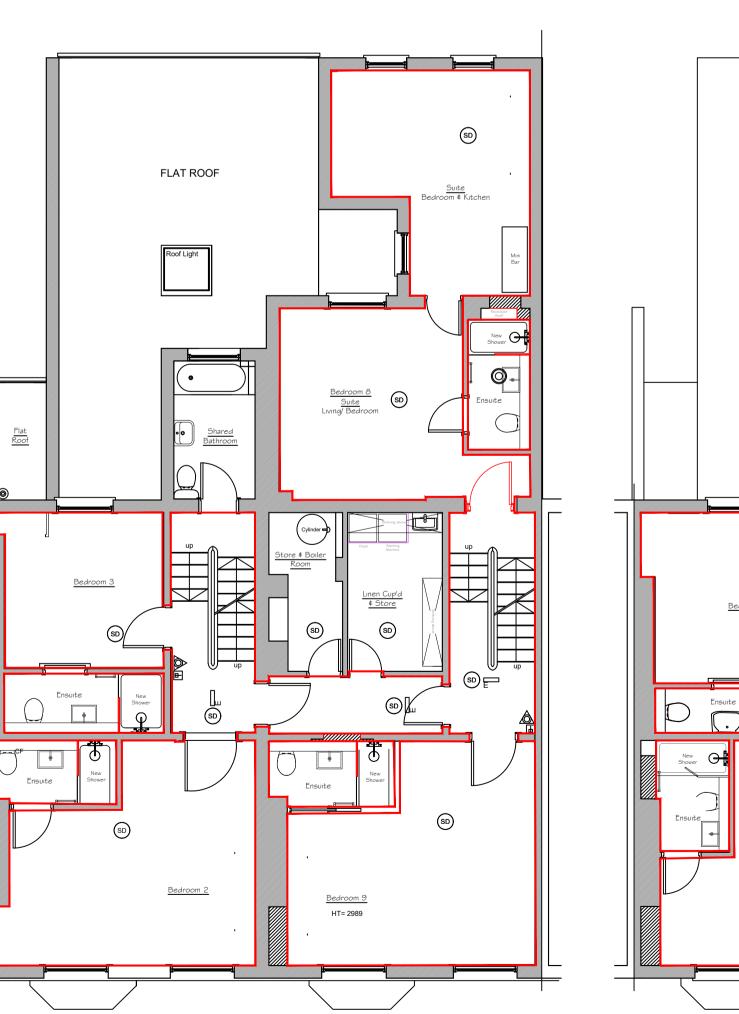

**Proposed First Floor Plan** 



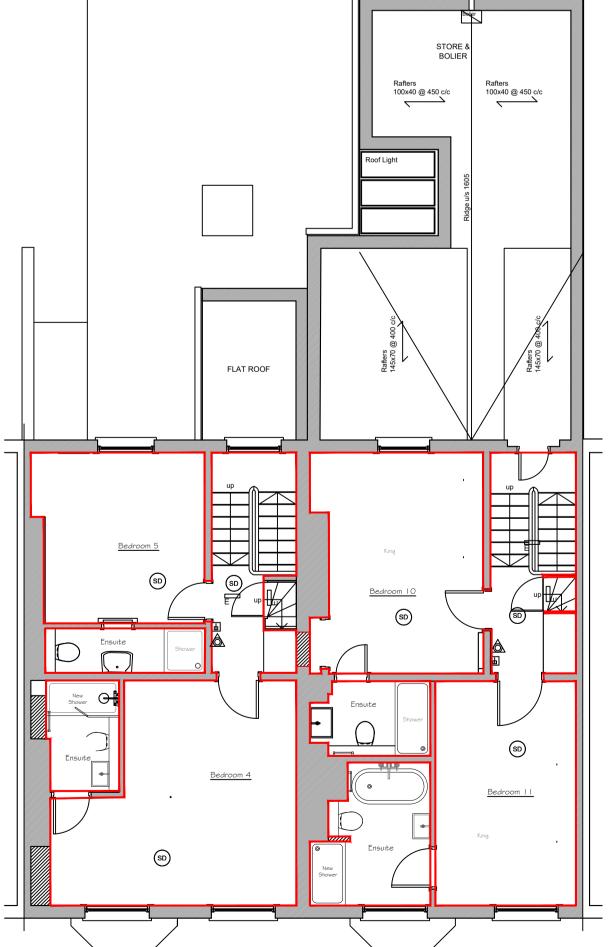



DO NOT SCALE. ALL DIMENSIONS TO BE CHECKED ON SITE BY CONTRACTOR. ALL MEASUREMENTS ARE IN MM UNLESS OTHERWISE SPECIFIED. WRITTEN DIMENSIONS TO BE USED IN PREFERENCE TO SCALED DIMENSIONS & ALL DISCREPANCIES TO BE REPORTED TO STUDIO TWO. THE DESIGN SHOWN ON THIS DRAWING IS THE PROPERTY OF STUDIO TWO AND IS NOT TO BE USED OR ITS CONTENTS COPIED, COMMUNICATED OR DISCLOSED, IN WHOLE OR IN PART.